



**Explanatory Paper for 2007  
Statement of Charges**

**1<sup>st</sup> January 2007 to 31<sup>st</sup> December 2007**

**Publication Date: 10/05/2007**

## **DOCUMENT HISTORY**

1. First published on the EirGrid website [www.eirgrid.com](http://www.eirgrid.com) on 10/05/2007.

## Table of Contents

<i>Document History</i> .....	2
<b>1 Introduction</b> .....	4
<b>2 Revenue requirement - 2007</b> .....	5
<b>3 Description of the Various Transmission Related Charges</b> .....	6
<b>3.1 Network Charge</b> .....	6
3.1.1 Network Capacity Charges.....	7
3.1.2 Network Transfer Charge.....	8
<b>3.2 System Services Charge</b> .....	8
<b>3.3 Capacity Margin Charge</b> .....	8
<b>3.4 Unauthorised Usage Charge (applies to DTS-T users only)</b> .....	9
<b>3.5 Change in level of MIC – (applies to DTS-T users only)</b> .....	9
<b>4 Generation Transmission Service</b> .....	11
<b>4.1 Generation Network Capacity charges</b> .....	11
<b>4.2 Treatment of embedded Generators (i.e. connected at distribution voltage)</b> .....	11
<b>4.3 Treatment of Intermittent &amp; Temporary Generation</b> .....	11
<b>4.4 Unit Trip Payments</b> .....	12
<b>4.5 Volatility: Generation tariffs</b> .....	12
4.5.1 Modification to the Methodology .....	12
<b>4.6 ‘Non firm’ transmission tariffs</b> .....	12
<b>4.7 Generator Commissioning Charge</b> .....	13
<b>5 Other Issues</b> .....	14
<b>5.1 Treatment of Autoproducers</b> .....	14
<b>5.2 Interconnector Service</b> .....	14
<b>5.3 Connection Offer Process Application Fees</b> .....	14
<i>Appendix 1: Metered Energy Calculation</i> .....	15
<i>Appendix 2: Tariff Calculation Example (Reverse MW-mile approach)</i> .....	16

## ***1 Introduction***

This paper describes the structure of EirGrid's Transmission Use of System (TUoS) charging regime for the period 1<sup>st</sup> January 2007 to 31<sup>st</sup> December 2007. The tariffs were approved by the Commission for Energy Regulation (CER) on 31<sup>st</sup> October 2006 and can be found in the 'Statement of Charges' which is available on EirGrid's website [www.eirgrid.com](http://www.eirgrid.com).

TUoS tariffs are designed to recover the total costs associated with the transmission business (i.e. the cost of both the Transmission System Operator (TSO) and Transmission Asset Owner (TAO) businesses). The total revenue to be recovered through TUoS is approved by the CER and in 2007 amounts to €291.9M. The transmission tariffs have been designed to fully recover the TUoS revenue requirement from transmission "users", which includes both generation and demand users connected directly to the transmission system or indirectly via the distribution system.

It should be noted that the demand tariffs approved for the year 2007 have been derived consistent with the methodology used to derive the tariffs since 2000. However the slight modification to the method used to calculate the Generator TUoS Network Capacity Charge for 2006 has again been implemented for 2007. The modification is explained in section 4.5.


The structure of this document is as follows. Section 2 outlines the revenue requirement as approved by the CER for the year 2007 and provides a breakdown of the proportions recovered from generation and demand users. A description of the various charges that apply to demand users is provided in section 3. Similarly, section 4 provides a detailed description of the generation tariff structure. Section 5 deals with Autoproducers, the Interconnector Service and Connection Offer Process Application Fees.

## 2 Revenue requirement - 2007

Figure 1 provides an overview of how the total revenue requirement as allowed by CER for the year 2007 (in year 2007 terms), is recovered from Generators and Demand Users. As illustrated, the total revenue allowed to operate the transmission system for year 2007 is €291.9M. This consists of Controllable costs sometimes referred to as “wires” related costs, (which includes costs associated with depreciation, rate of return, transmission maintenance, capital expenditure and EirGrid’s operating expenditure costs) totalling €88M and External costs or “non-wires” costs (which includes costs associated with Ancillary Services, Constraints and some DSO wires costs) totalling €103.9M.

As shown in Figure 1 below, 25% of the Controllable costs are recovered from generation and the remaining 75% from demand users. All External costs, with the exception of revenue received from generation trip payments, are recovered from demand users.

**Figure 1: Transmission Revenue Requirement for year 2007**

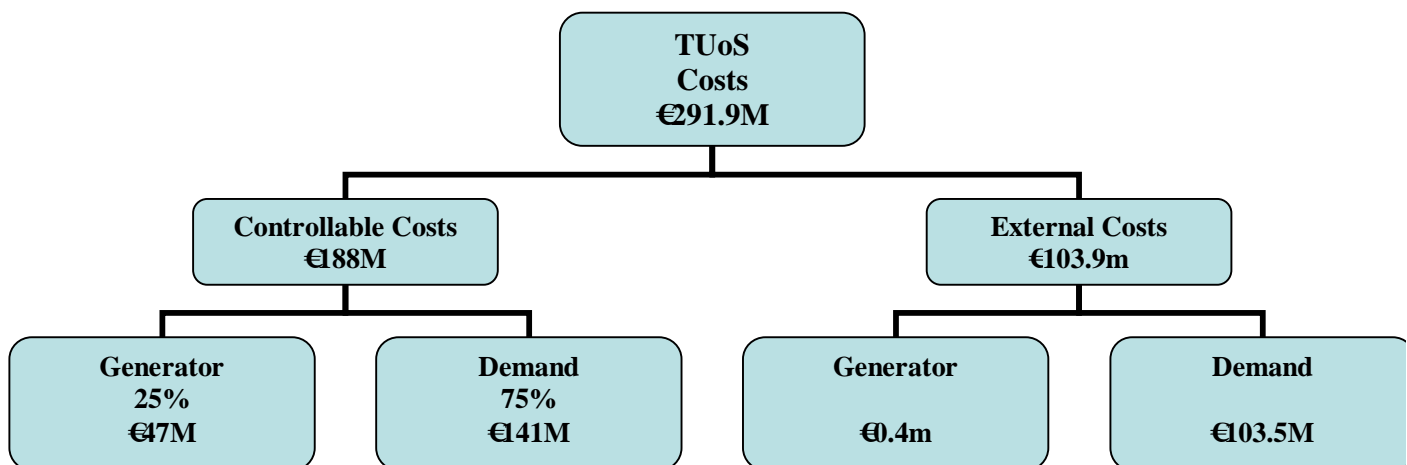

### ***3 Description of the Various Transmission Related Charges***

This section provides a description of the structure of the various transmission tariffs that apply to demand users.

There are three classes of Demand Transmission Service (DTS) provided by EirGrid.

**(1) Tariff Schedule DTS-T:** applies to suppliers serving customers connected directly to the transmission system.

**(2) Tariff Schedule DTS-D1:** applies to suppliers serving customers connected to the distribution system and having a Maximum Import Capacity of 0.5MW or above (before adjusting for the appropriate distribution loss factor).

**(3) Tariff Schedule DTS-D2:** applies to suppliers serving all other customers connected to the distribution system (including customers supplied by renewable energy suppliers or 'Green' customers) who are not served under the other tariff schedules noted above.

Suppliers on each of the three demand tariff schedules above are liable to pay the various transmission related charges as shown in the respective schedule in the Statement of Charges.

Transmission related charges comprise network charges and system services charges.

Network Charges are primarily related to recovery of wires costs. These recover the costs for the use of the transmission system infrastructure for the transportation of electricity in Ireland. 75% of the total wires related costs are recovered from demand users and the remaining 25% from generators, see Figure 2 below.

System Services Charges relate to the recovery of non-wires costs. These recover the costs arising from the operation and security of the transmission system. Specifically, these charges recover the costs associated with ancillary services, system support services and transmission constraints. EirGrid pays the costs of these services to the providers of such services and users pay EirGrid a System Services charge in respect of these costs.


#### **3.1 Network Charge**

Of the allowed revenue associated with the Network Charge (or wires costs) 75% are recovered from demand customers<sup>1</sup>. However, the Network Charge recovered from demand customers is not recovered solely on a capacity basis but instead on a split basis between capacity and energy, 60% is recovered on a capacity basis, through 'Network Capacity Charge' and the remaining 40% on an energy basis through 'Network Transfer Charge'. This effectively amounts to 45% of the total wires costs being allocated to the Network Capacity Charge.

---

<sup>1</sup> The remaining 25% is recovered from generation.

**Figure 2: Network Charge (Wires Cost)**

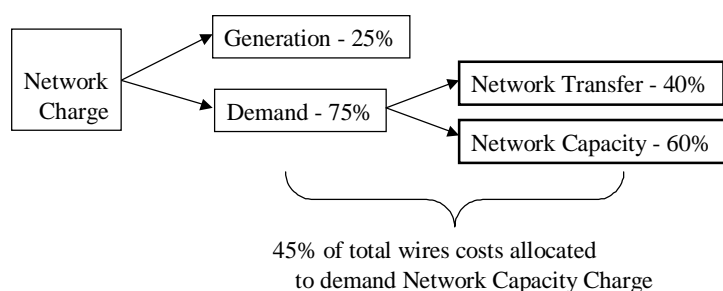

### 3.1.1 Network Capacity Charges

In relation to the allocation to Demand of the allowed transmission revenue associated with the wires related charges, 60% is allocated to Demand on a fixed basis through a per MW, Network Capacity Charge, or equivalent<sup>2</sup>. It is considered appropriate to recover a significant proportion of the charge on a fixed basis as the transmission network is primarily a fixed cost that, while designed to meet system “coincident peak”<sup>3</sup> at its core, must also be designed to meet the “non-coincident peak” at its extremities.

#### Network Capacity Charge - Tariff Schedule DTS-T

Transmission, or directly connected, customers are currently measured using profile (interval) metering and are contracted to a Maximum Import Capacity (MIC) under the Connection Agreement. This MIC value is used in assessing the capacity charges for each particular customer served by a supplier under Tariff Schedule DTS-T. The MIC value is the level to which EirGrid will design the transmission system to deliver electricity to the customer. The charge has been designed with a bandwidth to allow for a reasonable seasonal variation in demand.

#### Network Capacity Charge - Tariff Schedule DTS-D1

Distribution connected customers with a MIC of 0.5MW or above prior to adjusting for the appropriate distribution loss factor<sup>4</sup> are charged based on Tariff Schedule DTS-D1. This tariff schedule is very similar to Tariff Schedule DTS-T in that the distribution MIC value, after an adjustment for distribution losses, is used in assessing the capacity charge for each particular customer served by a supplier under this schedule. The charge has been similarly designed with a bandwidth to allow for a reasonable seasonal variation in demand.

The charge has also been modified to reflect the fact that distribution connected customers, through diversity of their demands, do not have the same effect on the transmission system at the Grid Exit Point as would a directly connected customer. Consequently, the network capacity charge for customers under the DTS-D1 schedule is below the corresponding charge under the DTS-T charge.

<sup>2</sup> The Network Capacity Charge under Tariff Schedule DTS-D2 is based on a per MWh during day hours as a proxy for per MW charging (this is discussed in more detail below).

<sup>3</sup> Within system planning criteria.

<sup>4</sup> See appendix 1 of this document for more details on application of distribution loss factors.

It has not been possible to charge all distribution connected eligible customers on the basis of the DTS-D1 tariff, as information on both MICs and profiled energy consumption for some of these customers is not available. Therefore these customers are charged on the basis of the DTS-D2 tariff, as a proxy for the DTS-D1 tariff. In time it is envisaged that relevant information will become available to charge all appropriate users on DTS-D1 tariff schedule.

#### Network Capacity Charge - Tariff Schedule DTS-D2

Distribution connected demand customers with an MIC value below the threshold of 0.5MW (prior to adjusting for the appropriate distribution loss factor) are charged based on Tariff Schedule DTS-D2. Under Tariff Schedule DTS-D2 the Network Capacity Charge is levied on a variable basis of consumption, which occurs during Day Hours<sup>5</sup>. Day Hour Recovery is considered an effective proxy for having MIC values for all DTS-D2 customers. The Network Capacity Charge for each user class for 2007 can be found in the 2007 Statement of Charges which is available on the website [www.eirgrid.com](http://www.eirgrid.com).

#### **3.1.2 Network Transfer Charge**

Of the allocation to Demand of the wires related costs, 40% is allocated to Demand on an energy basis through a, per MWh, Network Transfer Charge. Consequently, demand users (i.e. DTS-T, DTS-D1 and DTS-D2) are charged consistent with their associated usage.

Based on a forecast of total energy consumption and on the CER's allowed revenue for the year 2007 the Network Transfer Charge for the period, which is the same for all 3 classes of demand customer, can be found in the 2007 Statement of Charges (available on [www.eirgrid.com](http://www.eirgrid.com)). It should be noted however that the appropriate distribution loss factor will also be applied.

#### **3.2 System Services Charge**

Costs associated with system services are recovered almost entirely from demand users. This cost is recovered on an energy basis through a per MWh charge and it is based on year 2007 projections of system services costs and energy consumption. The 2007 Statement of Charges provides the System Services Charge for the period which is the same for all 3 classes of demand customer. It should be noted however that the appropriate distribution loss factor will also be applied.

#### **3.3 Capacity Margin Charge**

A specific charge designed to recover costs associated with the capacity margin was introduced in 2003 and as directed by the CER is recovered along with TUoS charges. Capacity Margin revenue is not part of Transmission Use of System revenue. This cost is recovered fully from demand users. All 3 classes of demand users are eligible

---

<sup>5</sup> Day Hours being 08:00 to 23:00 inclusive all days.

to pay this charge, which is noted in the 2007 Statement of Charges. It should be noted however that the appropriate distribution loss factor will also be applied.

### **3.4 Unauthorised Usage Charge (applies to DTS-T users only)**

In order to incentivise Demand Users to accurately predict their MIC values, so that EirGrid can develop the system cost effectively while meeting the necessary security standards, an unauthorised usage charge is applicable for demand users connected directly to the transmission system that exceed their MIC. This charge is provided in the 2007 Statement of Charges.

### **3.5 Change in level of MIC – (applies to DTS-T users only)**

As approved by CER on 04 February 2003 a period of 18 months notice is required from all Transmission connected customers who want to reduce their MIC. Customers must submit a modification request through the connection offer process. This requires a departing or reducing customer to contribute reasonable revenues in respect of the capacity, which was once provided at their request, now being unutilised and would allow any MIC changes to be incorporated in tariff determination. This notice period ensures that customers requesting changes to MIC values are doing so as a result of permanent changing needs and not for the purpose of avoiding capacity charges in the short-term. During the notice period customers would be charged based on their existing MIC for the Network Capacity Charge, hence ensuring all customers pay a minimum of eighteen months capacity charges for the originally requested MIC which the network was built to facilitate. However if another user or connecting party at the same Connection Point wishes to avail of unused capacity resulting from an MIC reduction, during the 18 month period following the reduction, then the original customer will not be liable for capacity charges in respect of this proportion of MIC from the date when the other user starts paying for that capacity.

Customers who request an increase in MIC have less of an effect on tariffs. Where possible the network can be developed to meet their request and they will be charged capacity charges based on the higher MIC value when it is delivered. Customers who bring about the need to enhance the network would be required to apply for a modification to their connection agreement by going through the normal connection offer process and commit to the increased MIC by providing a guarantee bond before necessary network construction works begin. This bond will be calculated based on the increased MW requested multiplied by the Network Capacity Charge (DTS-T tariff schedule) which applies on the date of the agreement multiplied by eighteen. Customers in this situation would also be required to pay any associated connection charges. Customers who request capacity that already exists will be granted the additional capacity without any connection costs being payable where there is no change to the shallow connection, network capacity charges will be payable based on the customer's higher MIC.

Please refer to “MIC Administration Policy for customers connected to the Transmission System” available on [www.eirgrid.com](http://www.eirgrid.com), for the background to the Unauthorised Usage Charge and other issues related to MIC Administration Policy.

## **4 Generation Transmission Service**

### **4.1 Generation Network Capacity charges**

Of the total allocation of network related costs, 25% is allocated to generation users. This cost is recovered using the Generation Capacity Charge.

Generators connected directly to the transmission system or indirectly via the distribution system<sup>6</sup> currently pay locational use-of-system charges, derived using the 'Reverse MW-mile' methodology. These charges, which are capacity based, provide efficient locational signals to generators in support of an overall efficient transmission system. The 2007 Statement of Charges provides firm generation tariffs for the year 2007. A detailed explanation of this methodology used to derive these charges is provided in Appendix 2 of this document.

### **4.2 Treatment of embedded Generators (i.e. connected at distribution voltage)**

Any generator connected to the distribution system with a capacity less than 10MW has a locational Network Capacity Charge rate of zero. Embedded generators greater than or equal to this threshold are liable for a site specific Generator Network Capacity Charge.

### **4.3 Treatment of Intermittent & Temporary Generation**

TUoS charges are designed to provide efficient pricing signals to generators connecting to the grid system. In calculating tariffs using the 'Reverse MW-mile' methodology, EirGrid credits those generators upon whom it is able to call upon to provide tangible system benefits through offsetting flows to the direction of dominant flow on the transmission system, and which thereby have the potential to reduce the need for future investment in the system. This can result in some generators having a negative overall TUoS charge. However, to date a lower bound of zero has been applied to generation which does not provide the level of system security from a planning perspective necessary to offset future investment requirements – wind generation due to its intermittent nature, and therefore inability of the system operator to call upon it should the need arise, and so called 'emergency' generators due to the nature of their temporary connection to the system. Neither generation which is intermittent in nature, nor that which is likely to be connected for only a limited period, is able to provide the requisite level of system support to the system operator. Crediting these generators for offsetting flows, recognising they have the potential to provide some system benefits, but capping the value of any offsets such that their overall TUoS charge should be no lower than zero, given that the system operator is unable to rely upon this generation to provide system support is felt to represent a reasonable compromise position.

---

<sup>6</sup> As discussed in section 4.2 embedded generators below the 10MW threshold have a zero rate for this charge.

#### **4.4 Unit Trip Payments**

Generators above 100MW are liable for two types of trip payments; the direct trip charge and the fast wind-down trip charge. These charges are payable each time a generator experiences a sudden and immediate loss of output. The 2007 Statement of Charges shows the charges per MW of trip output in excess of 100MW which generators will incur.

#### **4.5 Volatility: Generation tariffs**

The main objective of the reverse MW-mile methodology is to provide efficient locational signals to generators. However, a possible drawback of this approach from a generator's viewpoint is volatility resulting from the annual adjustments in tariffs faced by generators which result from changing local network conditions and changing local generation and load patterns. EirGrid has carried out a number of studies assessing the possible magnitude of the price volatility under a range of network development scenarios. Based on our analysis, generation TUoS charges have the potential to be relatively volatile, especially in a situation where large amounts of generation/load connect/disconnect from any location. EirGrid believes that mechanisms to reduce potential volatility are worthy of consideration. Bearing this in mind a slight modification, as described below, to the tariff calculation methodology was introduced to calculate the 2006 Generator Network Capacity Charges as approved by the CER. The modification to the method has again been implemented for 2007.

##### **4.5.1 Modification to the Methodology**

The modification involves calculating the percentage utilisation of every transmission line. The cost of lines where less than 20% of their rated capacity is used is set to €0 in the cost model. The cost model lists the costs of all transmission lines based on their annual replacement cost. Thus the revenue normally recovered/rebated on these lines is instead dealt with in the Postage Stamp Coverage. This modification should contribute to a less volatile tariff environment. Appendix 2 details the complete Generator TUoS methodology for a simple 6 bus system. EirGrid also intend to carry out a full review of the TUoS methodology to be completed in time for 2008. This review will mainly take place in the context of the Single Electricity Market (SEM).

#### **4.6 'Non firm' transmission tariffs**

The methodology described above applies to those generators who have reached their deep operational date as specified in their connection agreement or who have been 'deemed firm' by virtue of the CER's directions on firm and non-firm access to the transmission system. Generators who have not reached their deep operational date, or who are not 'deemed firm' are currently charged on a per MWh basis. These MWh charges are calculated using a site-specific charge per kilowatt per year (kW/year) calculated in the standard manner using the Reverse MW Mile approach. The kW charge is converted to a kWh charge by the application of an assumed availability

factor. These tariffs are sometimes referred to as a non-firm transmission tariff. The 'non-firm' transmission tariff is charged to all transmission connected (and distribution connected generators greater than or equal to 10MW) dispatchable generators for output in excess of the shallow connection capacity following the shallow connection date and prior to the Deemed Firm Date. This has been applied to conventional generation since the Firm/Non-Firm CER direction of 19<sup>th</sup> June 2001 CER/01/72. Wind generators were not subject to the Firm/Non-Firm direction and so this charge was never applied to them. Neither were they entitled to connection until the Deep Operational Date had been reached and all the associated system reinforcements were in place.

Subsequent to the CER direction of 8<sup>th</sup> July 2005 CER/05/107 recent and future renewable connection offers will be charged on this energy based tariff following the Shallow Operational Date and the receipt of an Operational Certificate, and will have access rights to the system at that time prior to the completion of all the associated transmission reinforcements. This takes into account the time lag in delivering the transmission reinforcement works associated with the large volume of connection applications which have been processed under the group processing arrangements.

This energy based tariff was only ever envisaged to be charged on a short term basis. As we have indicated above a purely energy based tariff is not very reflective of the costs of providing the network which have a significant fixed, or capacity element. However, to provide for access arrangements to comply with the CER direction of 8<sup>th</sup> July 2005 it will be extended in the short term until a comprehensive non-firm policy is put in place.

#### **4.7 Generator Commissioning Charge**

Generation Stations and Autoproducers may cause the TSO to incur incremental costs in respect of Ancillary Services, Congestion and Constraints during any commissioning or testing phase of the generator. Charges applied will follow those published in the 2007 Statement of Charges. To see details of the calculation methods for these charges please see the paper published on the EirGrid website "2005 Generator Testing Charges - Background and Calculation (22<sup>nd</sup> February 2005)".

In addition all generators are subject to an energy based charge during the commissioning/testing phase prior to the issuing of their Operational Certificate. This energy charge is derived in the same way as the 'Non-Firm' charge described above.

## **5 Other Issues**

### **5.1 Treatment of Autoproducers**

On 17<sup>th</sup> April 2002, the CER published a direction CER/02/37 addressing the issue of how autoproducers should be treated in the transmission charging regime. An autoproducer is defined as someone who produces essentially for his own use. On 25<sup>th</sup> September 2003 CER issued a direction CER/03/237 extending this to apply to all CHP generators.

CER have ruled that Autoproducers and CHP generators will pay Network Capacity Charges as either a demand user or a generator, but not both. Other TUoS charges are payable as both a demand user and generator as outlined in the 2007 Statement of Charges.

Autoproducers and CHP generators connected to the transmission system will pay Transmission Use of System tariffs under tariff schedule ATS-T. A User connected to the distribution system who is deemed to be an autoproducer will pay charges as outlined on tariff schedule ATS-D in Statement of Charges.

### **5.2 Interconnector Service**

Interconnector users must pay charges for use of the North-South Interconnector as outlined in Schedule ITS in the Statement of Charges. Interconnector Users exporting to Northern Ireland pay Interconnector usage charges to EirGrid. Details on the procedure for Interconnector Trading are available in “Agreed Procedure No. AP06 Interconnector Trading” of the Trading and Settlement Code available on the website ([www.eirgrid.com](http://www.eirgrid.com)). For South-North Interconnector auction details please also visit the EirGrid website. For North-South Interconnector auction details please visit the System Operator Northern Ireland (SONI) website [www.soni.ltd.uk](http://www.soni.ltd.uk).

### **5.3 Connection Offer Process Application Fees**

Connection Offer Process Application Fees apply to applicants who enter the connection offer process and are outlined in Schedule COPI in the Statement of Charges. The fee is dependent on the size (capacity) of the applicant’s development and whether shallow connection works are involved in dealing with the capacity required.

For further information please see the “Connection Offer Process” published on the EirGrid website. A separate schedule of Connection Offer Process application fees applies for Group Processing applicants. This schedule applies to parties that connect to the distribution or transmission system. These fees are also approved by the CER.

## Appendix 1: Metered Energy Calculation

This appendix provides an example of how a user's metered energy is adjusted by the applicable distribution loss factor to derive the metered energy value, as defined in EirGrid's Statement of Charges. While it is not shown here capacity charges are also adjusted by the applicable distribution loss factor.

The metered data files generated by MRSO contain average kW readings for each Demand Transmission customer for each fifteen minute interval, in each settlement day. The TUoS application system converts these kW readings to MWh readings by dividing each reading by 4000 (i.e.  $1000 \times 4$ ).

For example, consider a customer with a demand of 1400 kW and 1200 kW in two consecutive 15 minute periods in a given trading interval (i.e. half hour period). These kW readings are converted to MWh readings as follows:

$$1400 \text{ kW} \cdot 15 \text{ avg} / 1000 \text{ kW/MW} = 1.4 \text{ MW} \cdot 15 \text{ avg} / 4 \text{ MWh/MW} = 0.35 \text{ MWh}$$

$$1200 \text{ kW} \cdot 15 \text{ avg} / 1000 \text{ kW/MW} = 1.2 \text{ MW} \cdot 15 \text{ avg} / 4 \text{ MWh/MW} = 0.30 \text{ MWh}$$

These MWh readings are then adjusted by the relevant distribution loss factor and summed together to provide the total metered energy value in that trading period. The settlement day is divided into day hours and night hours, with different Distribution Loss Factors (DLF) applicable to day and night readings. Day hours are defined as 08:00 to 23:00 with night being 23:00 to 08:00.

So in our example, if we assume that the user is connected at 38kV and is a D1 customer, then assuming that the trading interval has occurred during day time hours, the metered energy value is equal to  $0.35 \times 1.019 + 0.30 \times 1.019$ .

In a billing period (i.e. in a given month) the network transfer charge and the system services charge are then derived by multiplying this metered energy value by the network transfer tariff rate and the system services tariff rate, respectively.

Capacity related charges are also levied for each billing period (i.e. month in question) consistent with the rules as outlined in EirGrid's Statement of Charges.

Table 1: Distribution loss factors 2007

Voltage	Day	Night
220 kV	1	1
110 kV	1	1
38 kV	1.020	1.017
MV	1.048	1.040
LV	1.097	1.083

Note: Day Hours = 08:00 to 23:00 hours inclusive on any day

## Appendix 2: Tariff Calculation Example (Reverse MW-mile approach)

This Appendix presents a detailed explanation of the Reverse MW-Mile approach applied to an example small system, comprising 6 buses and 8 circuits. This approach is used to derive EirGrid's generation locational transmission charges. All calculations are carried out using a specialised software package called 'Integra'.

There are three main steps involved in deriving generation charges:

- (1) the use of each circuit by each generator is determined using load flow analysis. This analysis requires the specification of generation and demand at each point on the network. The load flow study then calculates the flow of all power from generators to demand sinks, based on peak load conditions.
- (2) transmission assets are valued based on replacement costs. The cost of each circuit includes a depreciation charge, operations and maintenance overheads plus an appropriate rate of return. Station costs are apportioned to each line connecting into that station on a per bay basis. Only lines where more than 20% of their rated capacity is used are included in the model.
- (3) Generators are charged for each circuit in direct proportion to their contribution. A key feature of the Reverse MW-mile approach is that generators which off-set flows are rewarded, by crediting counter-flows. Due mainly to the lumpiness of transmission investment, at any given point in time, spare capacity (i.e. differences between the rated capacity of an asset and the extent to which is used by all network users) will exist on the transmission system. The cost associated with the spare capacity on all circuits is averaged across all users (as opposed to charging the full cost of a circuit to the specific users of each circuit).

### Illustrative Example

A simple 6 bus system illustrated below is used to provide an understanding of the workings of the Reverse MW-mile approach.

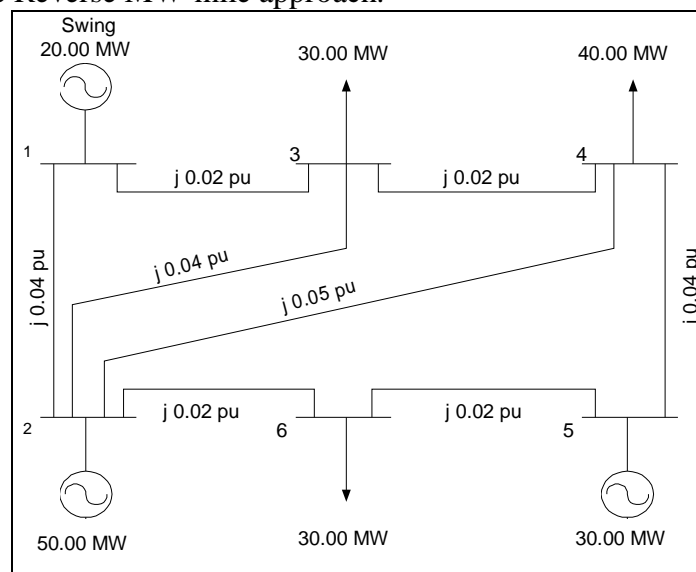


Figure 2 – System Example

This system is assumed to have 3 generators serving a total system demand of 100MW. For simplicity the capacity of all circuits is assumed to be 50MW and the annual value (i.e. includes depreciation, RoR and O&M) of each circuit is assumed to be €50,000.

### Step 1(a) – Load Flow Calculation

A DC power flow is calculated to identify the circuit flows of the system. It is important to determine the direction of the flow in each circuit caused by each generator. If the circuit flow caused by the generator and the total circuit flow in a circuit are in the same direction, the flow is called ‘dominant’. If the flows are in opposite direction to the dominant flow, the flow is called ‘reverse’. When the generator is responsible for a dominant flow, then that generator is increasing the flow in the circuit, and pays for its use. However, if a generator is responsible for a reverse flow, then that generator is reducing the flow in the circuit, and receives credit for postponing the expansion of the transmission system.

To determine the contribution of each generator to circuit flows it is necessary first to run a load flow that matches total system demand and generation.

The formulation of the linear power flow (DC approach) is presented below:

$$P_{ij} = x_{ij}^{-1} \cdot \theta_{ij} \quad P_{ij} = \text{circuit flow (pu)} - \text{base 100 MVA}$$

$$x_{ij} = \text{circuit reactance (pu)}$$

$$\theta_{ij} = \text{angle between the buses i and j (rad)}$$

$$P_i = \sum x_{ij}^{-1} \cdot \theta_{ij} \quad P_i = \text{net injection} = P_{Gi} - P_{Li} \text{ (pu)}$$

$$P_i = \left( \sum x_{ij}^{-1} \right) \cdot \theta_i + \left( \sum -x_{ij}^{-1} \right) \cdot \theta_j$$

In matrix form:

$$P = B \cdot \theta$$

$$B_{ij} = -x_{ij}^{-1}$$

$$B_{ii} = \sum x_{ij}^{-1}$$

Using the numerical values of the system example:

$$P = B \cdot \theta$$

$$\begin{bmatrix} 0.20 \\ 0.50 \\ -0.30 \\ -0.40 \\ 0.30 \\ -0.30 \end{bmatrix} = \begin{bmatrix} 75 & -25 & -50 & 0 & 0 & 0 \\ -25 & 120 & -25 & -20 & 0 & -50 \\ -50 & -25 & 125 & -50 & 0 & 0 \\ 0 & -20 & -50 & 95 & -25 & 0 \\ 0 & 0 & 0 & -25 & 75 & -50 \\ 0 & -50 & 0 & 0 & -50 & 100 \end{bmatrix} \cdot \begin{bmatrix} \theta_1 = 0 \\ \theta_2 \\ \theta_3 \\ \theta_4 \\ \theta_5 \\ \theta_6 \end{bmatrix}$$

However, the matrix B is singular, so it doesn't have an inverse. Consequently, it is necessary to reduce the matrix by the terms of the swing bus (bus 1).

$$P = B' \theta$$

$$\begin{bmatrix} 0.50 \\ -0.30 \\ -0.40 \\ 0.30 \\ -0.30 \end{bmatrix} = \begin{bmatrix} 120 & -25 & -20 & 0 & -50 \\ -25 & 125 & -50 & 0 & 0 \\ -20 & -50 & 95 & -25 & 0 \\ 0 & 0 & -25 & 75 & -50 \\ -50 & 0 & 0 & -50 & 100 \end{bmatrix} \cdot \begin{bmatrix} \theta_2 \\ \theta_3 \\ \theta_4 \\ \theta_5 \\ \theta_6 \end{bmatrix}$$

To calculate the value of the angle,  $\theta_{ij}$ , and after that the circuit flow  $P_{ij}$ , it is necessary to solve this equation:

$$\theta = (B')^{-1} \cdot P$$

$$\begin{bmatrix} \theta_2 \\ \theta_3 \\ \theta_4 \\ \theta_5 \\ \theta_6 \end{bmatrix} = (B')^{-1} \cdot P = \begin{bmatrix} 0.0013 \\ -0.0046 \\ -0.0062 \\ 0.0005 \\ -0.0021 \end{bmatrix}$$

The flow in each circuit is obtained by the expression:

$$P_{ij} = -B_{ij} \cdot \theta_{ij}$$

Also included below is the percentage utilisation of each circuit based on the line capacities of 50MW.

$$P_{12} = -B_{12} \cdot q_{12} = 25 \cdot (-1.284 \cdot 10^{-3}) = -0.0321 pu = -3.21 MW \rightarrow \frac{3.21}{50} = 6.42\%$$

$$P_{13} = -B_{13} \cdot q_{13} = 50 \cdot (4.642 \cdot 10^{-3}) = 0.2321 pu = 23.21 MW \rightarrow \frac{23.21}{50} = 46.42\%$$

$$P_{23} = -B_{23} \cdot q_{23} = 25 \cdot (5.924 \cdot 10^{-3}) = 0.1481 pu = 14.81 MW \rightarrow \frac{14.81}{50} = 29.62\%$$


$$P_{24} = -B_{24} \cdot q_{24} = 20 \cdot (7.530 \cdot 10^{-3}) = 0.1506 pu = 15.06 MW \rightarrow \frac{15.06}{50} = 30.12\%$$

$$P_{26} = -B_{26} \cdot q_{26} = 50 \cdot (3.382 \cdot 10^{-3}) = 0.1691 pu = 16.91 MW \rightarrow \frac{16.91}{50} = 33.82\%$$

$$P_{34} = -B_{34} \cdot q_{34} = 50 \cdot (1.604 \cdot 10^{-3}) = 0.0802 pu = 8.02 MW \rightarrow \frac{8.02}{50} = 16.04\%$$

$$P_{45} = -B_{45} \cdot q_{45} = 25 \cdot (-6.764 \cdot 10^{-3}) = -0.1691 pu = -16.91 MW \rightarrow \frac{16.91}{50} = 33.82\%$$

$$P_{56} = -B_{56} \cdot q_{56} = 50 \cdot (2.618 \cdot 10^{-3}) = 0.1309 pu = 13.09 MW \rightarrow \frac{13.09}{50} = 26.18\%$$

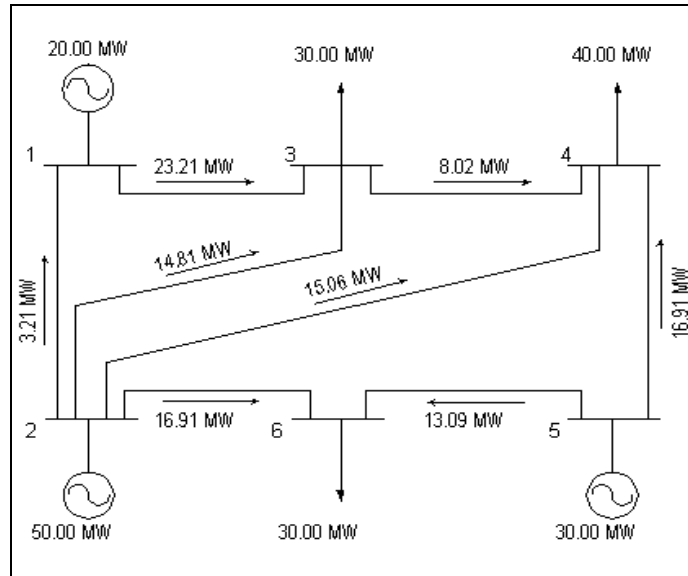

### Circuit Flows

System Generation = Generation Bus1 + Generation Bus2 + Generation Bus5  
 System Generation = 20 + 50 + 30 = 100 MW

#### Step (1b) – Power flow caused by each generator

To calculate the circuit flow caused by each generator we run a power flow representing all generators except the one we are studying. The total system load should be reduced proportionally to match the system dispatch. The flow in each circuit caused by the generator we are studying is equal to the total flow in the circuit (i.e. basecase scenario) minus the flow we obtain when running a loadflow without the generator under study.

After calculating the circuit flows, and determining whether flows are dominant or reverse, we calculate the locational signal (MW-Mile Tariff before applying the Postage Stamp Coverage) associated with each generator.

#### Generator at Bus 1 – Calculating Circuit Flows

System Generation = 80 MW = 0.80 pu  
 Generation at Bus 1 = 0 MW = 0.00 pu  
 Generation at Bus 2 = 50 MW = 0.50 pu  
 Generation at Bus 5 = 30 MW = 0.30 pu

Load at Bus 3 = 30% x 80MW = 24 MW = 0.24 pu  
 Load at Bus 4 = 40% x 80MW = 32 MW = 0.32 pu  
 Load at Bus 6 = 30% x 80MW = 24 MW = 0.24 pu

$$\begin{bmatrix} \theta_2 \\ \theta_3 \\ \theta_4 \\ \theta_5 \\ \theta_6 \end{bmatrix} = \mathbf{B}^{-1} \cdot \mathbf{P} = \mathbf{B}^{-1} \cdot \begin{bmatrix} 0.50 \\ -0.24 \\ -0.32 \\ 0.30 \\ -0.24 \end{bmatrix} = \begin{bmatrix} 4.1218 \\ -2.0609 \\ -2.4132 \\ 4.4543 \\ 1.8881 \end{bmatrix} \cdot 10^{-3}$$

$$P_{12} = -B_{12} \cdot \theta_{12} = 25 \cdot (-4.1218 \cdot 10^{-3}) = -0.1030 \text{ pu} = -10.30 \text{ MW}$$

$$P_{13} = -B_{13} \cdot \theta_{13} = 50 \cdot (2.0609 \cdot 10^{-3}) = 0.1030 \text{ pu} = 10.30 \text{ MW}$$

$$P_{23} = -B_{23} \cdot \theta_{23} = 25 \cdot (6.1827 \cdot 10^{-3}) = 0.1545 \text{ pu} = 15.45 \text{ MW}$$


$$P_{24} = -B_{24} \cdot \theta_{24} = 20 \cdot (6.5350 \cdot 10^{-3}) = 0.1307 \text{ pu} = 13.07 \text{ MW}$$

$$P_{26} = -B_{26} \cdot \theta_{26} = 50 \cdot (2.2337 \cdot 10^{-3}) = 0.1117 \text{ pu} = 11.17 \text{ MW}$$

$$P_{34} = -B_{34} \cdot \theta_{34} = 50 \cdot (0.3523 \cdot 10^{-3}) = 0.0176 \text{ pu} = 1.76 \text{ MW}$$

$$P_{45} = -B_{45} \cdot \theta_{45} = 25 \cdot (-6.8675 \cdot 10^{-3}) = -0.1716 \text{ pu} = -17.16 \text{ MW}$$

$$P_{56} = -B_{56} \cdot \theta_{56} = 50 \cdot (2.5663 \cdot 10^{-3}) = 0.1284 \text{ pu} = 12.84 \text{ MW}$$

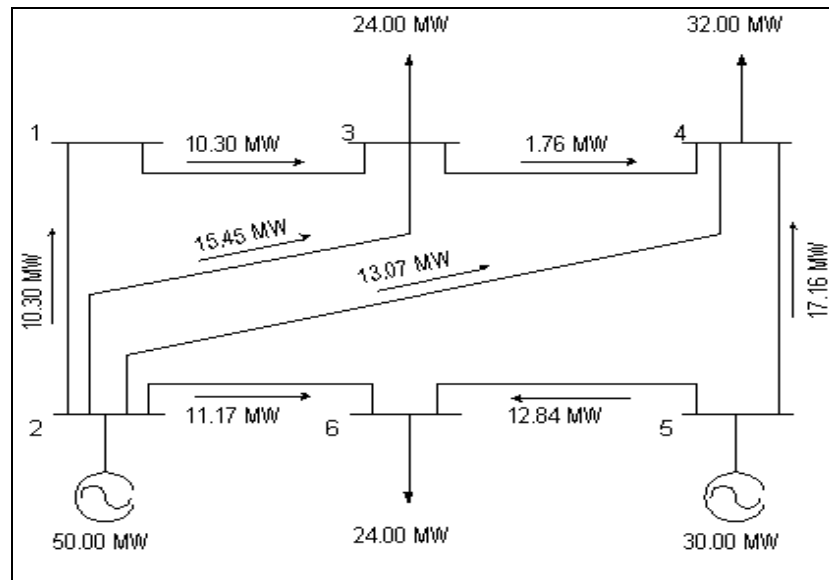

**Circuit Flows Obtained Without Generator 1**

Report of Circuit Flows:

CIRCUIT	TOTAL (MW)	GENERATOR 2 + GENERATOR 5 (MW)	GENERATOR 1 (MW)
1 – 2	-3.21	-10.30	+7.09 (R)
1 – 3	23.21	10.30	+12.91 (D)
2 – 3	14.81	15.45	-0.64 (R)
2 – 4	15.06	13.07	+1.99 (D)
2 – 6	16.91	11.17	+5.74 (D)
3 – 4	8.02	1.76	+6.26 (D)
4 – 5	-16.91	-17.16	+0.25 (R)
5 – 6	13.09	12.84	+0.25 (D)

Note: The circuit flow caused by generator 1 is calculated as the total circuit flow minus the circuit flow caused by the generators 2 and 5. “R” and “D” denote reverse and dominant flows respectively. If the flow caused by generator 1 is in the same direction as the total flow then it is a dominant flow. If the flow caused by generator 1 is in the opposite direction to the total flow then it is a reverse flow.

### Generator at Bus 2 – Calculating Circuit Flows

System Generation = 50 MW = 0.50 pu

Generation at Bus 1 = 20 MW = 0.20 pu

Generation at Bus 2 = 0 MW = 0.00 pu

Generation at Bus 5 = 30 MW = 0.30 pu

Load at Bus 3 = 30% x 50 MW = 15 MW = 0.15 pu

Load at Bus 4 = 40% x 50 MW = 20 MW = 0.20 pu

Load at Bus 6 = 30% x 50 MW = 15 MW = 0.15 pu

$$\begin{bmatrix} \theta_2 \\ \theta_3 \\ \theta_4 \\ \theta_5 \\ \theta_6 \end{bmatrix} = B^{-1} \cdot P = B^{-1} \cdot \begin{bmatrix} 0.00 \\ -0.15 \\ -0.20 \\ 0.30 \\ -0.15 \end{bmatrix} = \begin{bmatrix} -1.9095 \\ -3.0453 \\ -3.6584 \\ 1.7160 \\ -1.5967 \end{bmatrix} \cdot 10^{-3}$$

$$P_{12} = -B_{12} \cdot \theta_{12} = 25 \cdot (1.9095 \cdot 10^{-3}) = 0.0477 \text{ pu} = 4.77 \text{ MW}$$

$$P_{13} = -B_{13} \cdot \theta_{13} = 50 \cdot (3.0453 \cdot 10^{-3}) = 0.1523 \text{ pu} = 15.23 \text{ MW}$$

$$P_{23} = -B_{23} \cdot \theta_{23} = 25 \cdot (1.1358 \cdot 10^{-3}) = 0.0283 \text{ pu} = 2.83 \text{ MW}$$


$$P_{24} = -B_{24} \cdot \theta_{24} = 20 \cdot (1.7490 \cdot 10^{-3}) = 0.0350 \text{ pu} = 3.50 \text{ MW}$$

$$P_{26} = -B_{26} \cdot \theta_{26} = 50 \cdot (-0.3127 \cdot 10^{-3}) = -0.0157 \text{ pu} = -1.57 \text{ MW}$$

$$P_{34} = -B_{34} \cdot \theta_{34} = 50 \cdot (0.6132 \cdot 10^{-3}) = 0.0306 \text{ pu} = 3.06 \text{ MW}$$

$$P_{45} = -B_{45} \cdot \theta_{45} = 25 \cdot (-5.3745 \cdot 10^{-3}) = -0.1343 \text{ pu} = -13.43 \text{ MW}$$

$$P_{56} = -B_{56} \cdot \theta_{56} = 50 \cdot (3.3127 \cdot 10^{-3}) = 0.1657 \text{ pu} = 16.57 \text{ MW}$$

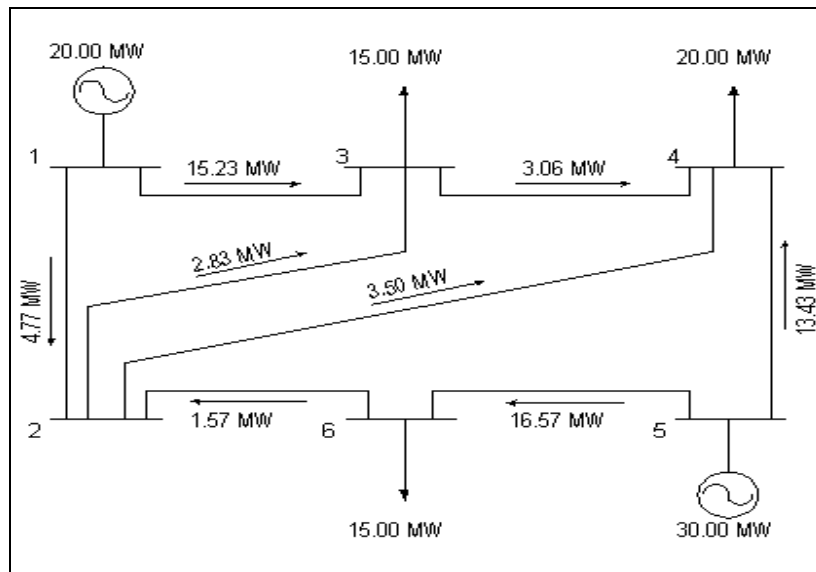

**Circuit Flows Obtained Without Generator 2**

Report of Circuit Flows:

CIRCUIT	TOTAL (MW)	GENERATOR 1 + GENERATOR 5 (MW)	GENERATOR 2 (MW)
1 – 2	-3.21	4.77	-7.98 (D)
1 – 3	23.21	15.23	+7.98 (D)
2 – 3	14.81	2.83	+11.98 (D)
2 – 4	15.06	3.50	+11.56 (D)
2 – 6	16.91	-1.57	+18.48 (D)
3 – 4	8.02	3.06	+4.96 (D)
4 – 5	-16.91	-13.43	-3.48 (D)
5 – 6	13.09	16.57	-3.48 (R)

Note: The circuit flow caused by generator 2 is calculated as the total circuit flow minus the circuit flow caused by the generators 1 and 5.

### Generator at Bus 5 – Calculating Circuit Flows

System Generation = 70 MW = 0.70 pu  
 Generation at Bus 1 = 20 MW = 0.20 pu  
 Generation at Bus 2 = 50 MW = 0.50 pu  
 Generation at Bus 5 = 0 MW = 0.00 pu

Load at Bus 3 = 30% x 70 MW = 21 MW = 0.21 pu  
 Load at Bus 4 = 40% x 70 MW = 28 MW = 0.28 pu  
 Load at Bus 6 = 30% x 70 MW = 21 MW = 0.21 pu

$$\begin{bmatrix} \theta_2 \\ \theta_3 \\ \theta_4 \\ \theta_5 \\ \theta_6 \end{bmatrix} = B^{-1} \cdot P = B^{-1} \cdot \begin{bmatrix} 0.50 \\ -0.21 \\ -0.28 \\ 0.00 \\ -0.21 \end{bmatrix} = \begin{bmatrix} 0.3555 \\ -4.1778 \\ -6.4222 \\ -5.1333 \\ -4.4889 \end{bmatrix} \cdot 10^{-3}$$

$$P_{12} = -B_{12} \cdot \theta_{12} = 25 \cdot (-0.3555 \cdot 10^{-3}) = -0.0089 \text{ pu} = -0.89 \text{ MW}$$

$$P_{13} = -B_{13} \cdot \theta_{13} = 50 \cdot (4.1778 \cdot 10^{-3}) = 0.2089 \text{ pu} = 20.89 \text{ MW}$$

$$P_{23} = -B_{23} \cdot \theta_{23} = 25 \cdot (4.5333 \cdot 10^{-3}) = 0.1133 \text{ pu} = 11.33 \text{ MW}$$


$$P_{24} = -B_{24} \cdot \theta_{24} = 20 \cdot (6.7778 \cdot 10^{-3}) = 0.1355 \text{ pu} = 13.55 \text{ MW}$$

$$P_{26} = -B_{26} \cdot \theta_{26} = 50 \cdot (4.8444 \cdot 10^{-3}) = 0.2422 \text{ pu} = 24.22 \text{ MW}$$

$$P_{34} = -B_{34} \cdot \theta_{34} = 50 \cdot (2.2444 \cdot 10^{-3}) = 0.1122 \text{ pu} = 11.22 \text{ MW}$$

$$P_{45} = -B_{45} \cdot \theta_{45} = 25 \cdot (-1.2889 \cdot 10^{-3}) = -0.03215 \text{ pu} = -3.215 \text{ MW}$$

$$P_{56} = -B_{56} \cdot \theta_{56} = 50 \cdot (-0.6444 \cdot 10^{-3}) = -0.03215 \text{ pu} = -3.215 \text{ MW}$$

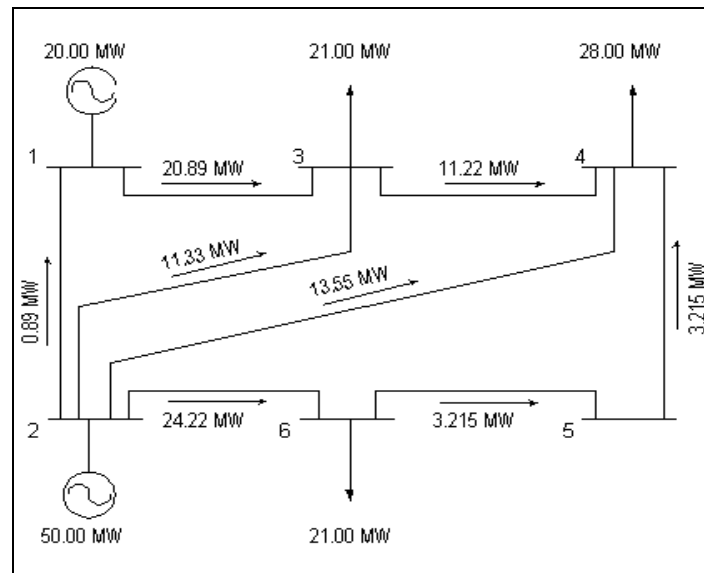

### Circuit Flows Obtained Without Generator 5

Report of Circuit Flows:

CIRCUIT	TOTAL (MW)	GENERATOR 1 + GENERATOR 2 (MW)	GENERATOR 5 (MW)
1 – 2	-3.21	-0.89	-2.32 (D)
1 – 3	23.21	20.89	+2.32 (D)
2 – 3	14.81	11.33	+3.48 (D)
2 – 4	15.06	13.55	+1.51 (D)
2 – 6	16.91	24.22	-7.31 (R)
3 – 4	8.02	11.22	-3.20 (R)
4 – 5	-16.91	-3.215	-13.70 (D)
5 – 6	13.09	-3.215	+16.31 (D)

Note: The circuit flow caused by generator 5 is calculated as the total circuit flow minus the circuit flow caused by the generators 1 and 2.

### Summary Report of Circuit Flows

CIRCUITS	TOTAL	GENERATOR 1 (20 MW)	GENERATOR 2 (50 MW)	GENERATOR 5 (30 MW)
1 – 2	-3.21	+7.09 (R)	-7.98 (D)	-2.32 (D)
1 – 3	23.21	+12.91 (D)	+7.98 (D)	+2.32 (D)
2 – 3	14.81	-0.64 (R)	+11.98 (D)	+3.48 (D)
2 – 4	15.06	+1.99 (D)	+11.56 (D)	+1.51 (D)
2 – 6	16.91	+5.74 (D)	+18.48 (D)	-7.31 (R)
3 – 4	8.02	+6.26 (D)	+4.96 (D)	-3.20 (R)
4 – 5	-16.91	+0.25 (R)	-3.48 (D)	-13.70 (D)
5 – 6	13.09	+0.25 (D)	-3.48 (R)	+16.31 (D)

### Step 2 Costs associated with each circuit

For simplicity (as discussed above) it is assumed that the value of each circuit is equal to €50,000 except those circuits where less than 20% of their capacity is used. These circuits have an assumed value of €0.

CIRCUIT	COST (€)	CAPACITY (MW)
1 – 2	0	50
1 – 3	$50 \cdot 10^3$	50
2 – 3	$50 \cdot 10^3$	50
2 – 4	$50 \cdot 10^3$	50
2 – 6	$50 \cdot 10^3$	50
3 – 4	0	50
4 – 5	$50 \cdot 10^3$	50
5 – 6	$50 \cdot 10^3$	50

### Step 3: Deriving generation locational charges

Given the results of the loadflow analysis and using the cost assumptions provided above, in this section we derive the locational signals for the simple system under study.

## Generator at bus 1

CIRCUIT	COST (€)	CAPACITY (MW)	GENERATOR'S POWER FLOW (MW)	DIRECT (D) OR REVERSE (R)	LOCATIONAL SIGN PAYMENT (€)
1 – 2	0	50	7.09	R	0
1 – 3	$50 \cdot 10^3$	50	12.91	D	12910.00
2 – 3	$50 \cdot 10^3$	50	-0.64	R	-640.00
2 – 4	$50 \cdot 10^3$	50	1.99	D	1990.00
2 – 6	$50 \cdot 10^3$	50	5.74	D	5740.00
3 – 4	0	50	6.26	D	0
4 – 5	$50 \cdot 10^3$	50	0.25	R	-250.00
5 – 6	$50 \cdot 10^3$	50	0.25	D	250.00
				TOTAL	20000.00

$$p_i = \frac{\sum_{k=1}^{nlin} \frac{c_k}{k_k} \cdot w_k^i}{G_i} \quad (\text{€kW}) \quad (1)$$

$$R_i = p_i \cdot PG_i^{MAX} \quad (\text{€}) \quad (2)$$

where

$p_i$  = locational tariff for generator i

$c_k$  = cost of circuit k

$k_k$  = capacity of circuit k

$w_k^i$  = circuit flow caused by generator i on circuit k

$G_i$  = dispatch of generator i

$R_i$  = amount paid by the generator at bus i

$PG_i^{MAX}$  = MEC of generator i

Applying the formulas (1) and (2) above to the generator at bus 1:

$$p_1 = \frac{\sum_{k=1}^{nlin} \frac{c_k}{k_k} \cdot w_k^1}{G_1} = \frac{50 \cdot 10^3 (\text{€}) \cdot (12.91 - 0.64 + 1.99 + 5.74 - 0.25 + 0.25) \text{MW}}{50 \text{MW} \cdot 20 \text{MW}}$$

$$p_1 = \text{€}1.0000/\text{kW}$$

$$R_1 = p_i \cdot PG_i^{MAX} = \text{€}1.0000/\text{kW} \cdot (20 \text{MW}) = \text{€}20,000$$

### Generator at bus 2

CIRCUIT	COST (€)	CAPACITY (MW)	GENERATOR'S POWER FLOW (MW)	DIRECT (D) OR REVERSE (R)	LOCATIONAL SIGN PAYMENT (€)
1 – 2	0	50	-7.98	D	0
1 – 3	$50 \cdot 10^3$	50	7.98	D	7980.00
2 – 3	$50 \cdot 10^3$	50	11.98	D	11980.00
2 – 4	$50 \cdot 10^3$	50	11.56	D	11560.00
2 – 6	$50 \cdot 10^3$	50	18.48	D	18480.00
3 – 4	0	50	4.96	D	0
4 – 5	$50 \cdot 10^3$	50	-3.48	D	3480.00
5 – 6	$50 \cdot 10^3$	50	-3.48	R	-3480.00
TOTAL					50000.00

Applying the formulas (1) and (2) above to the generator at bus 2:

$$p_2 = \frac{\sum_{k=1}^{n_{lin}} \frac{c_k}{k_k} \cdot w_k^2}{G_2} = \frac{50 \cdot 10^3 (\text{€})}{50 \text{ MW}} \cdot \frac{(7.98 + 11.98 + 11.56 + 18.48 + 3.48 - 3.48) \text{ MW}}{50 \text{ MW}}$$

$$p_2 = \text{€}1.0000$$

$$R_2 = p_2 \cdot PG_2^{\text{MAX}} = \text{€}1.0000 / \text{kW} \cdot (50 \text{ MW}) = \text{€}50,000$$

### Generator at bus 5

CIRCUIT	COST (€)	CAPACITY (MW)	GENERATOR'S POWER FLOW (MW)	DIRECT (D) OR REVERSE (R)	LOCATIONAL SIGN PAYMENT (€)
1 – 2	0	50	-2.32	D	0
1 – 3	$50 \cdot 10^3$	50	2.32	D	2320.00
2 – 3	$50 \cdot 10^3$	50	3.48	D	3480.00
2 – 4	$50 \cdot 10^3$	50	1.51	D	1510.00
2 – 6	$50 \cdot 10^3$	50	-7.31	R	-7310.00
3 – 4	0	50	-3.20	R	0
4 – 5	$50 \cdot 10^3$	50	-13.70	D	13700.00
5 – 6	$50 \cdot 10^3$	50	16.31	D	16310.00
TOTAL					30010.00

Applying the formulas (1) and (2) above to the generator at bus 5:

$$p_5 = \frac{\sum_{k=1}^{nlin} \frac{c_k}{k_k} \cdot W_k^5}{G_5} = \frac{50 \cdot 10^3 (\text{€}) \cdot (2.32 + 3.48 + 1.51 - 7.31 + 13.70 + 16.31) MW}{50 MW \cdot 30 MW}$$

$$p_5 = \text{€}1.0003 / kW$$

$$R_5 = p_5 \cdot PG_5^{MAX} = \text{€}1.0003 / kW \cdot (30 MW) = \text{€}30,010$$

### Postage Stamp Coverage

The locational sign is not sufficient to recover the total transmission system cost. To cover the total transmission system cost, it will be necessary to share among the generators the costs associated with unused capacity. The Postage Stamp (or average) coverage is the methodology used to distribute this cost among the generators. This methodology is presented below:

Transmission Revenue: 8 circuits x 50 · 10<sup>3</sup> (€) = 400 · 10<sup>3</sup> (€)

Total Revenue by Locational Sign = R<sub>1</sub> + R<sub>2</sub> + R<sub>5</sub> = (20.00+50.00+30.01) · 10<sup>3</sup> = 100.01 · 10<sup>3</sup> (€)

Transmission system cost not remunerated: 400 · 10<sup>3</sup> – 100.01 · 10<sup>3</sup> = 299.99 · 10<sup>3</sup> (€)

Postage Stamp:  $\Delta = \frac{299.99 \cdot 10^3 (\text{€})}{100 \cdot 10^3 kW} = 2.9999 (\text{€}) / kW$

BUS NUMBER	LOCATIONAL SIGNAL TARIFF (€kW)	POSTAGE STAMP TARIFF (€kW)	TOTAL TARIFF (€kW)
1	1.0000	2.9999	3.9999
2	1.0000	2.9999	3.9999
5	1.0003	2.9999	4.0002

### Report of Total Generation Payment:

BUS NUMBER	GENERATION (MW)	LOCATIONAL SIGN PAYMENT (€)	POSTAGE STAMP PAYMENT (€)	TOTAL PAYMENT (€)
1	20	20000	59998	79998
2	50	50000	149995	199995
5	30	30010	89997	120007
TOTAL	100	100010	299990	400000